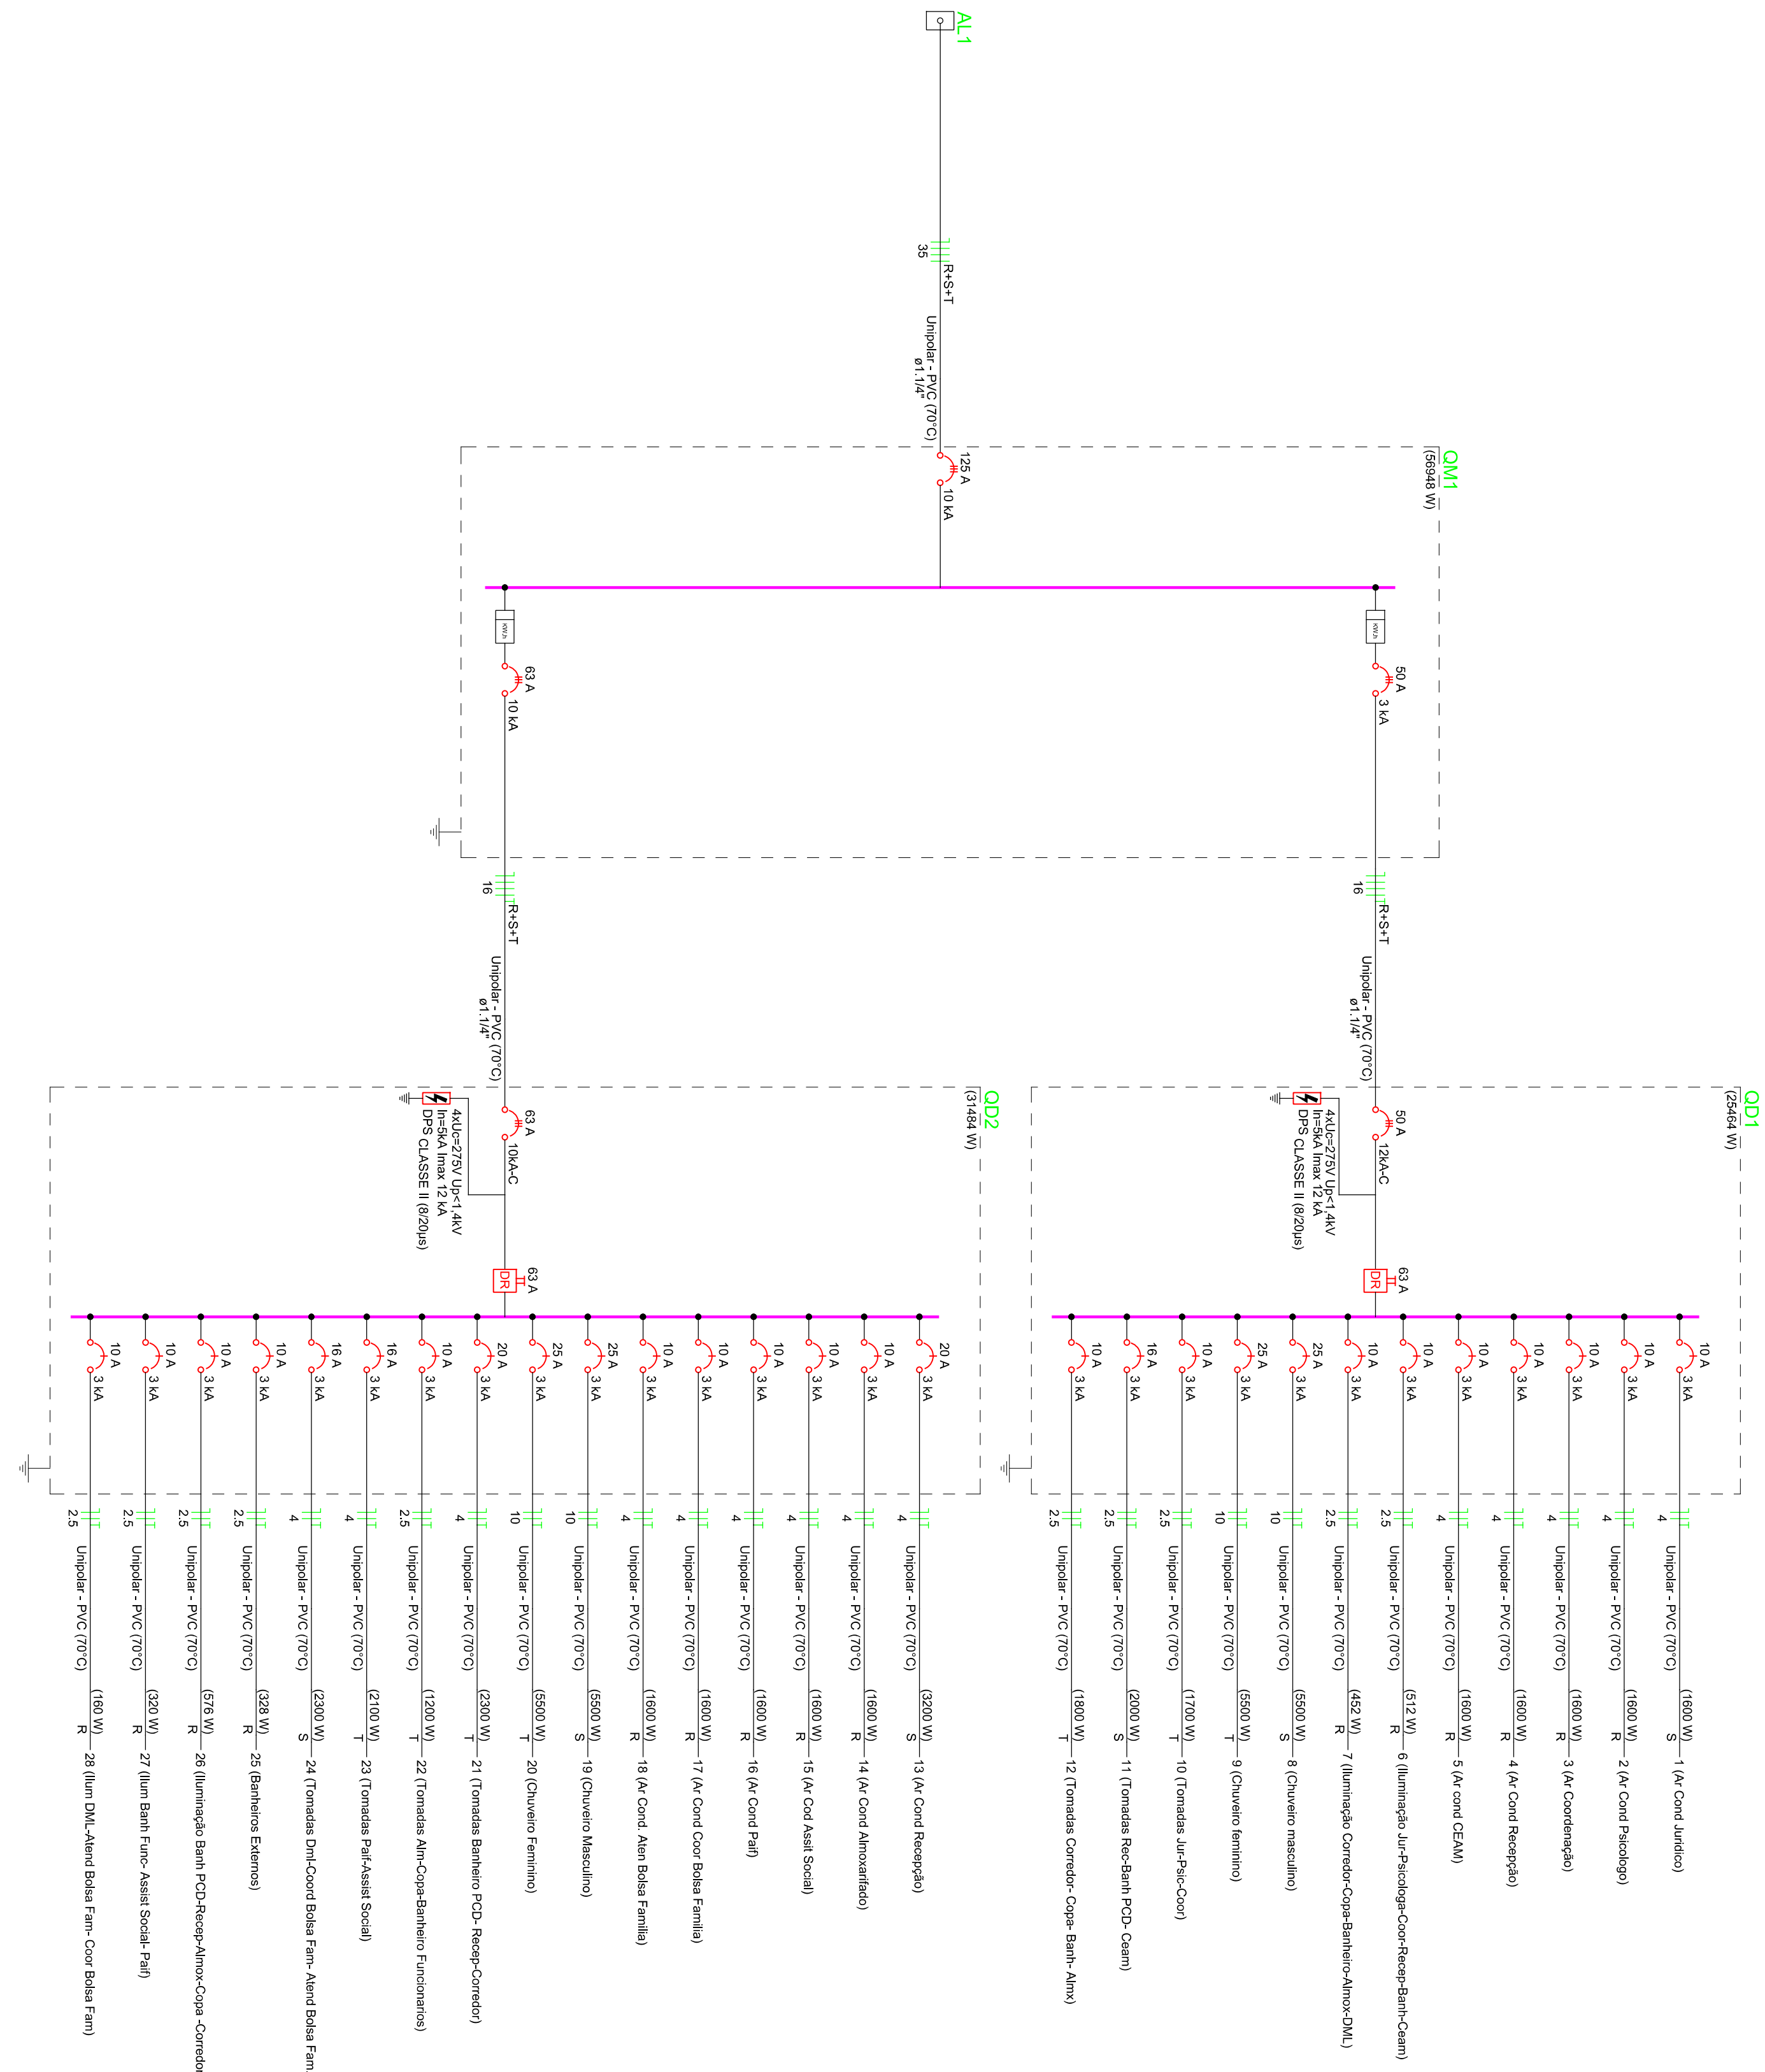
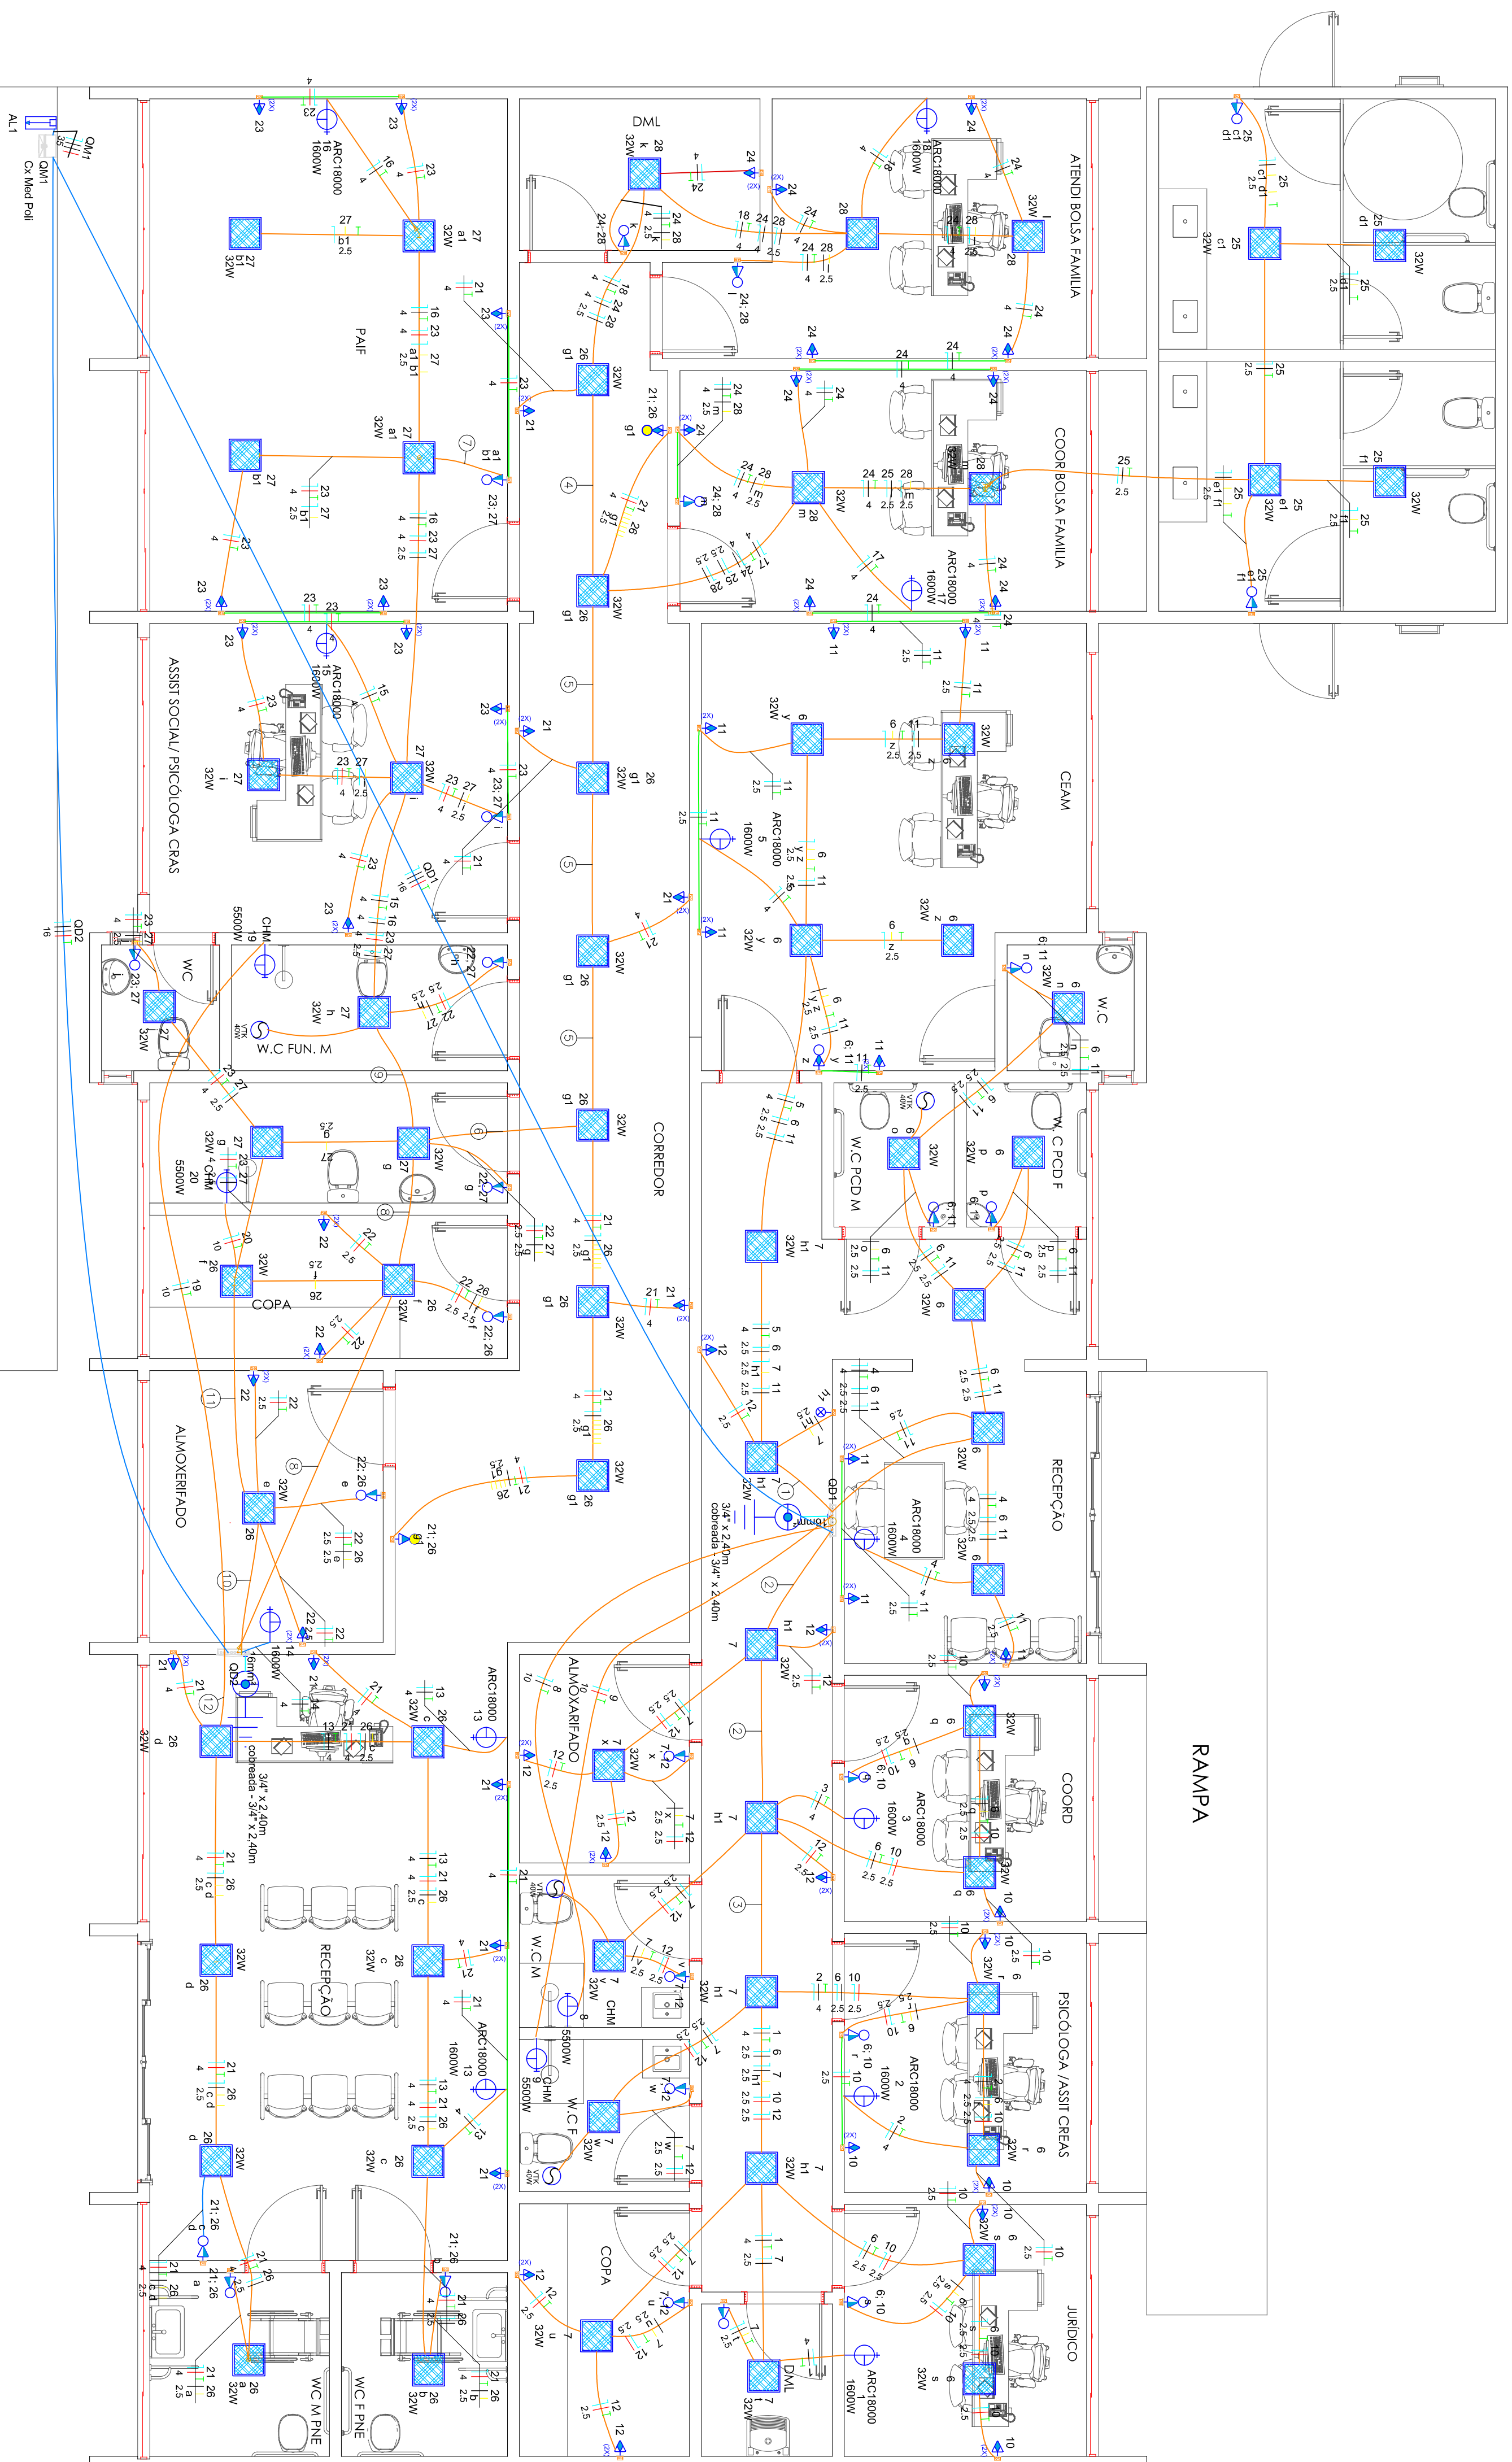


[illegible][illegible]

Classificação	Descrição	Pol. total	Pol. total	Fedat. Pol. - C	Pol. - S	Pol. - T	FCT	FCI	IR	IP	Suplo	IC	Loc	Dag	At. perc	At. total	Status
00000	Esquema de mado	7263	7263	7263	7263	7263	7263	7263	7263	7263	7263	7263	7263	7263	7263	7263	OK
001	3F+M+T	27263	2464	R+S+T	7064	9100	9600	1,00	1,00	43,2	43,2	16	66,0	3	50	0,85	OK
002	3F+M+T	34023	31464	R+S+T	9364	11000	11000	1,00	1,00	52,8	52,8	16	66,0	10	63	1,00	OK
004	B1	386220 V	34023	R+S+T	9364	11000	11000	1,00	1,00	52,8	52,8	16	66,0	10	63	1,00	OK
006	61268	61268	6646	R+S+T	16746	20100	20100	1,00	1,00	52,8	52,8	16	66,0	10	63	1,00	OK

Cuadro de Demanda (CM1) - Pavimento			
Tipo de carga	Política instalada (kVA)	Factor de demanda (%)	Demanda (kVA)
Tornasas condominio (Residencial)	2.56	20.00	0.51
Uso Específico	58.73	100.00	58.73
	TOTAL		59.24

Legenda de Injeto - Pavimento

1) 5, 6, 7, 11, 12
4 25 25,5 25

2) 1, 2, 3, 6, 7, 10
4 4 2,5 25 25

3) 1, 2, 6, 7, 10, 12
4 4 2,5 25 25

4) 18, 21, 24, 26, 28
4 4 2,5 25

5) 17, 18, 21, 24, 25, 26
4 4 2,5 25

6) 17, 18, 21, 24, 25, 26
4 4 2,5 25

7) 23, 27
4 2,5

8) 15, 16, 17, 18, 21, 22
2,5 2,5 2,5 2,5 2,5 2,5
4 2,5 2,5 2,5 2,5 2,5

9) 15, 16, 22, 23, 27
4 2,5 4 2,5 4 2,5

10) 20, 22, 25, 26, 27
10 2,5 4 2,5 2,5

11) 20, 23, 26, 27
10 4 2,5 2,5

12) 13, 21, 26
4 4 2,5

[illegible]