
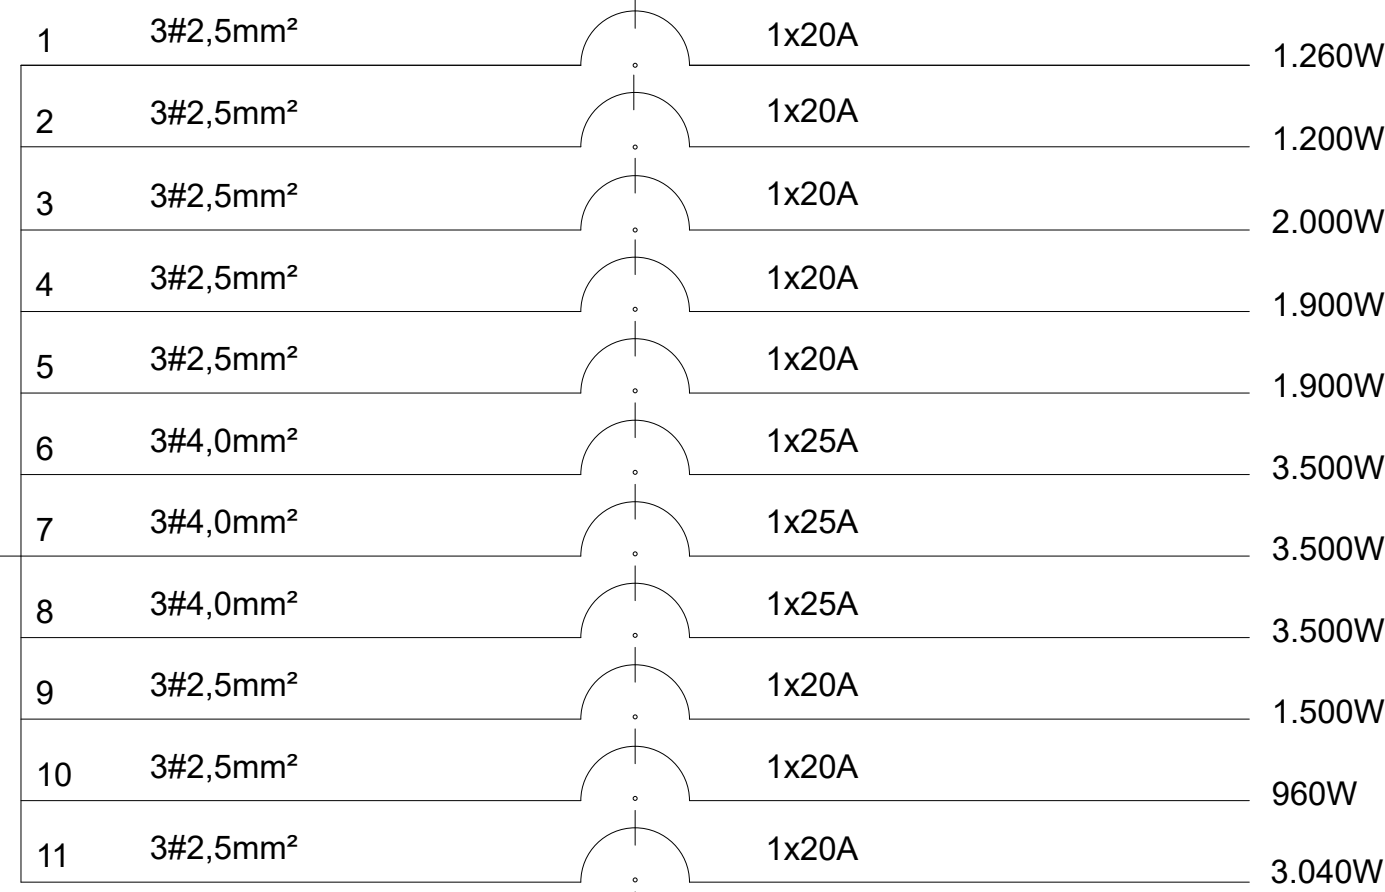
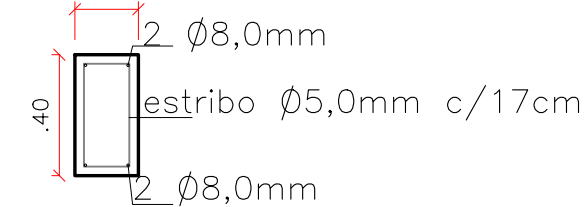
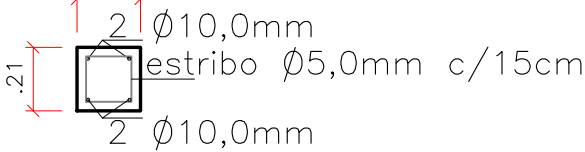
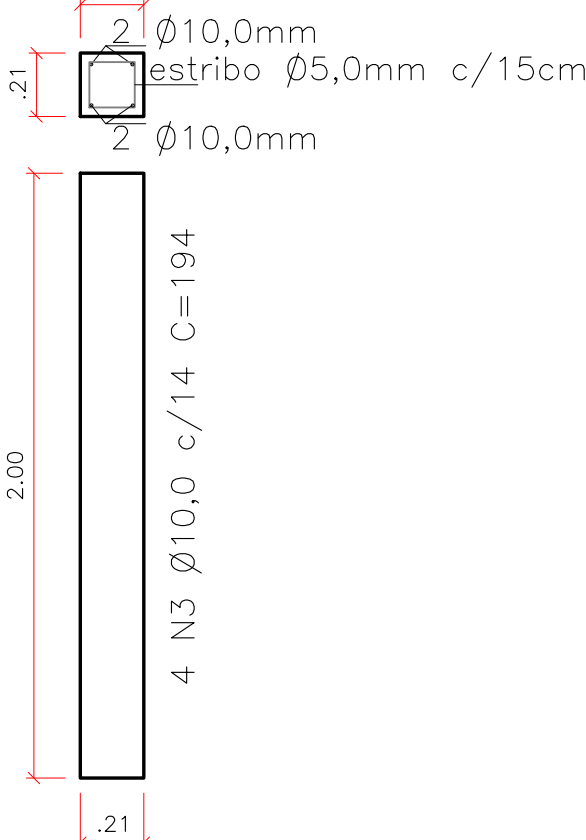


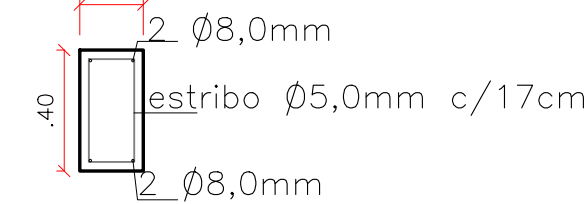

QUADRO DE CARGAS																
ILUMINAÇÃO				TOMADAS		CARGAS ESPECIAIS			CARGAS (W)	CONDUTOR (mm²)	PROTEÇÃO DISI. (A)		FASES			FINALIDADE
CIRCUITOS	60W	100W	160W	220W	100W	600W	COND. AR 1,9 kW	COND. AR 3,5 kW	CHUVEIRO 5,4kW		DISI. (A)	DR (30mA) (A)	R	S	T	
01	01	06		06						1.260	2,5	1x20		1.260		MISTO
				12						1.200	2,5	1x20		1.200		TOMADAS
02					12					2.000	2,5	1x20		2.000		MISTO
04							01			1.900	2,5	1x20		1.900		AR CONDICIONADO
05						01				1.900	2,5	1x20	1.900			AR CONDICIONADO
06							01			3.500	4,0	1x25				AR CONDICIONADO
07							01			3.500	4,0	1x25	3.500	3.500		AR CONDICIONADO
08							01			3.500	4,0	1x25		3.500		AR CONDICIONADO
09		06				09				1.500	2,5	1x20		1.500		MISTO
10	06	06								960	2,5	1x20		960		ILUMINAÇÃO
TOTAL	07	26	00	00	39	00	02	03	00	21.220	0mm²	3x32	-	10.320	10.900	ALIMENTAÇÃO
11	14	22								3.040	2,5	1x20		3.040		ILUMINAÇÃO EXTERNA